




TWO-45° "Y'S" WITH CLEANOUT.

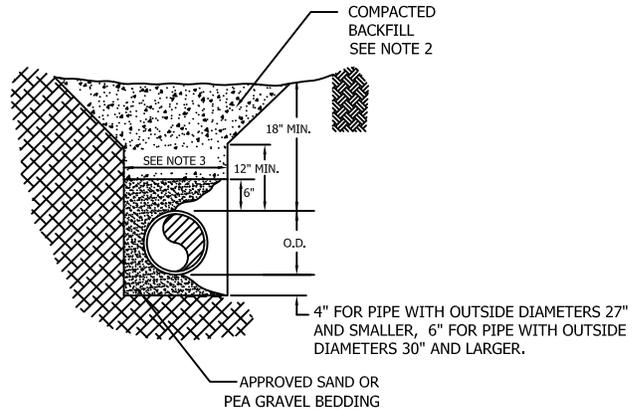

**B** TRENCH SECTION

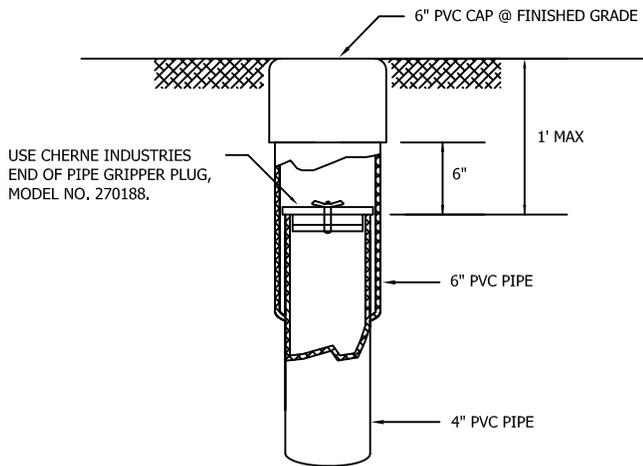

**C** CLEANOUT GASKET DETAIL

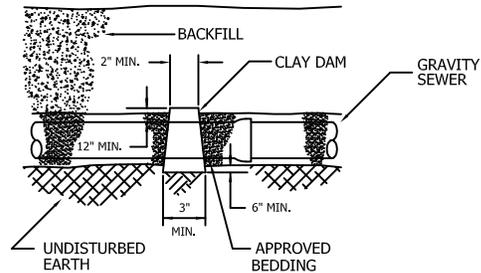

**D** CLAY DAM  
NOTE 1

1. THE CITY MAY REQUIRE THAT A DAM CONSTRUCTED OF CLAY OR IMPERVIOUS NATIVE MATERIAL BE INSTALLED IN THE PIPE ZONE IMMEDIATELY DOWNSTREAM AREAS WHERE EXCESS SURFACE AND GROUND WATER WILL LIKELY BEGIN TO FLOW IN THE PIPE BEDDING, (IE WETLANDS, UNDER STORM WATER INFILTRATION SYSTEMS ETC.) THE DAM SHALL BE KEYPED INTO THE TRENCH BOTTOM AND SIDES A MINIMUM OF 6" AND COVER OVER THE PIPE 12" MINIMUM. THE DAM BASE SHALL BE A MINIMUM OF 3' LONG AND THE TOP SHALL BE A MINIMUM OF 2' LONG, AS MEASURED ALONG THE PIPE.

0	update	tmc		
NO.	REVISION DESCRIPTION	PREP'D BY	DATE	APPROVED

**STANDARD  
SANITARY SIDE SEWER  
CONNECTION DETAILS**

<b>CITY OF BLAINE PUBLIC WORKS DEPARTMENT</b>			
SIZE <b>A</b>	PREV. DWG. NO.	PUBLIC WORKS DRAWING NUMBER <b>5-12</b>	
SCALE <i>NONE</i>	SHEET <b>OF</b>	REV. NO.	

